
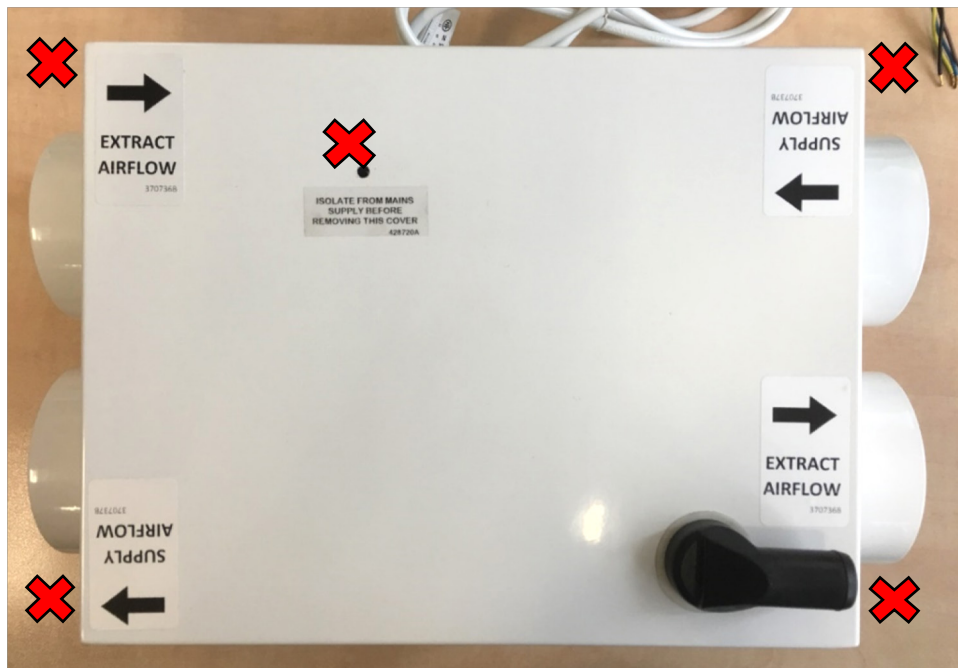
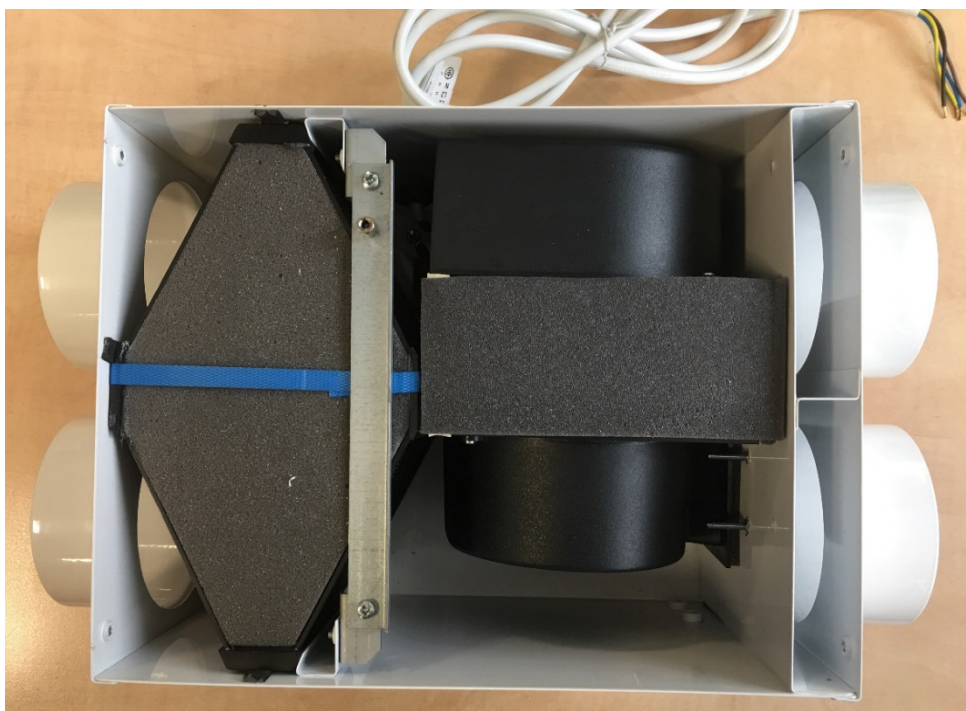


How to insert filter textile into HR 100R / HR 100 RS HRV units


1. Switch off the unit.
2. Unscrew the 5 screws from both sides and from the front cover, see 



3. Remove the cover.



4. Insert the filter textile into the existing slot (fresh cold air inlet into the building).

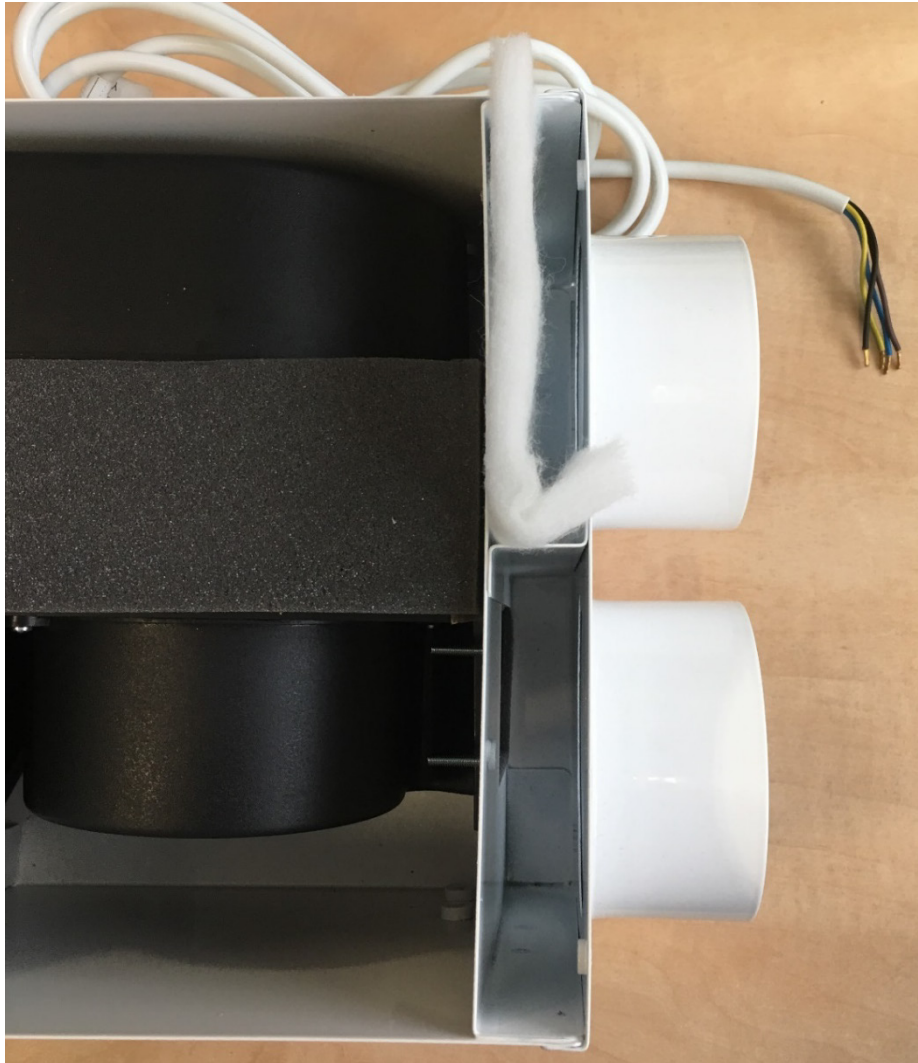

5. Screw the cover to its original place.